



P1	Preliminary Release	2/6/06	
P2	See PDC 60321-01	3/22/06	
P3	See PDC 60505-01	5/05/06	

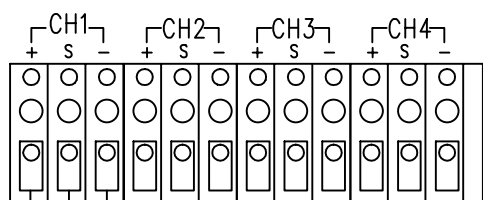


Beacon 800
Detector/Transmitter
Terminal Strip

BEACON 800 HOUSING

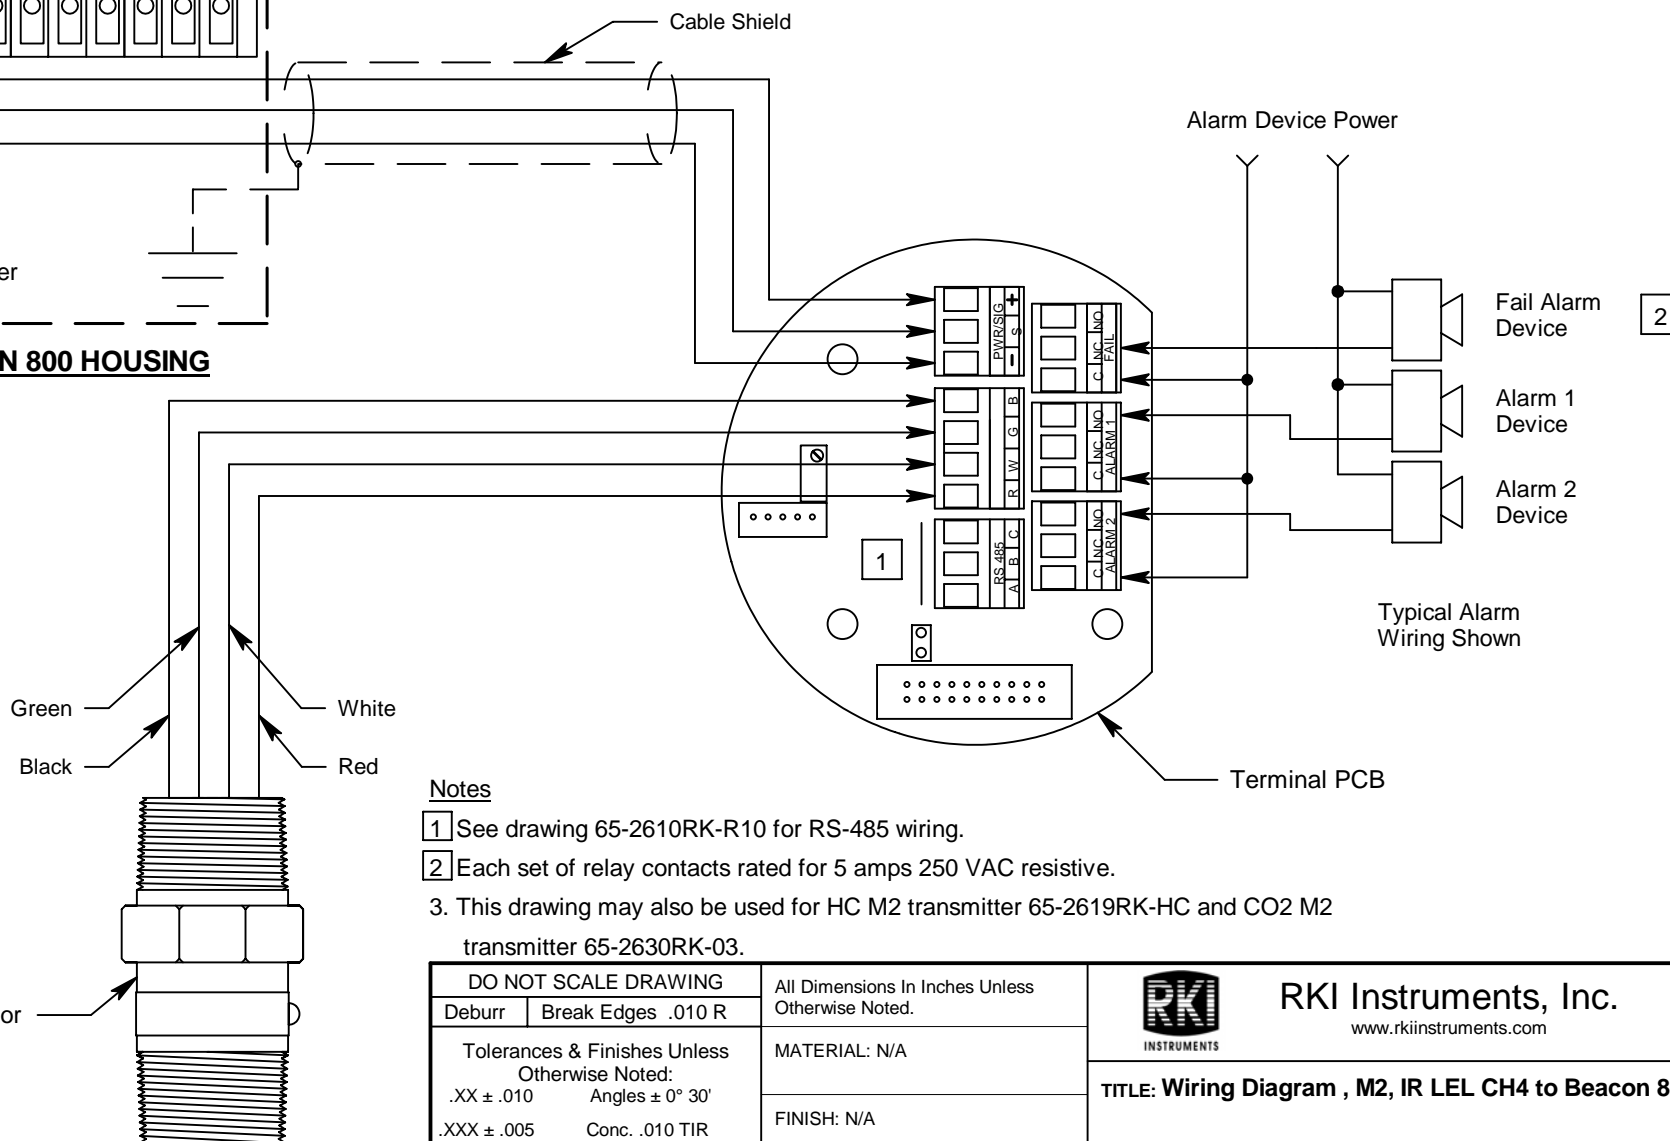

Notes

- 1 See drawing 65-2610RK-R10 for RS-485 wiring.
- 2 Each set of relay contacts rated for 5 amps 250 VAC resistive.
3. This drawing may also be used for HC M2 transmitter 65-2619RK-HC and CO2 M2 transmitter 65-2630RK-03.

DO NOT SCALE DRAWING		All Dimensions In Inches Unless Otherwise Noted.		<div> RKI Instruments, Inc. www.rkiinstruments.com</div>	
Deburr	Break Edges .010 R				
Tolerances & Finishes Unless Otherwise Noted: .XX ± .010 Angles ± 0° 30' .XXX ± .005 Conc. .010 TIR Fractions ± .015 Finish 125/32		MATERIAL: N/A		TITLE: Wiring Diagram , M2, IR LEL CH4 to Beacon 800	
FINISH: N/A					
Finish for O-ring Grooves, 3 Sides 32/		SCALE:None		APPROVED BY:	
				DATE: 2/6/06	
				PAGE 1 OF 1	