



| | | | |
|----|--------------------------|----------|--|
| P1 | Preliminary Release | 11/23/05 | |
| 0 | Release per ECR 51129-01 | 12/16/05 | |

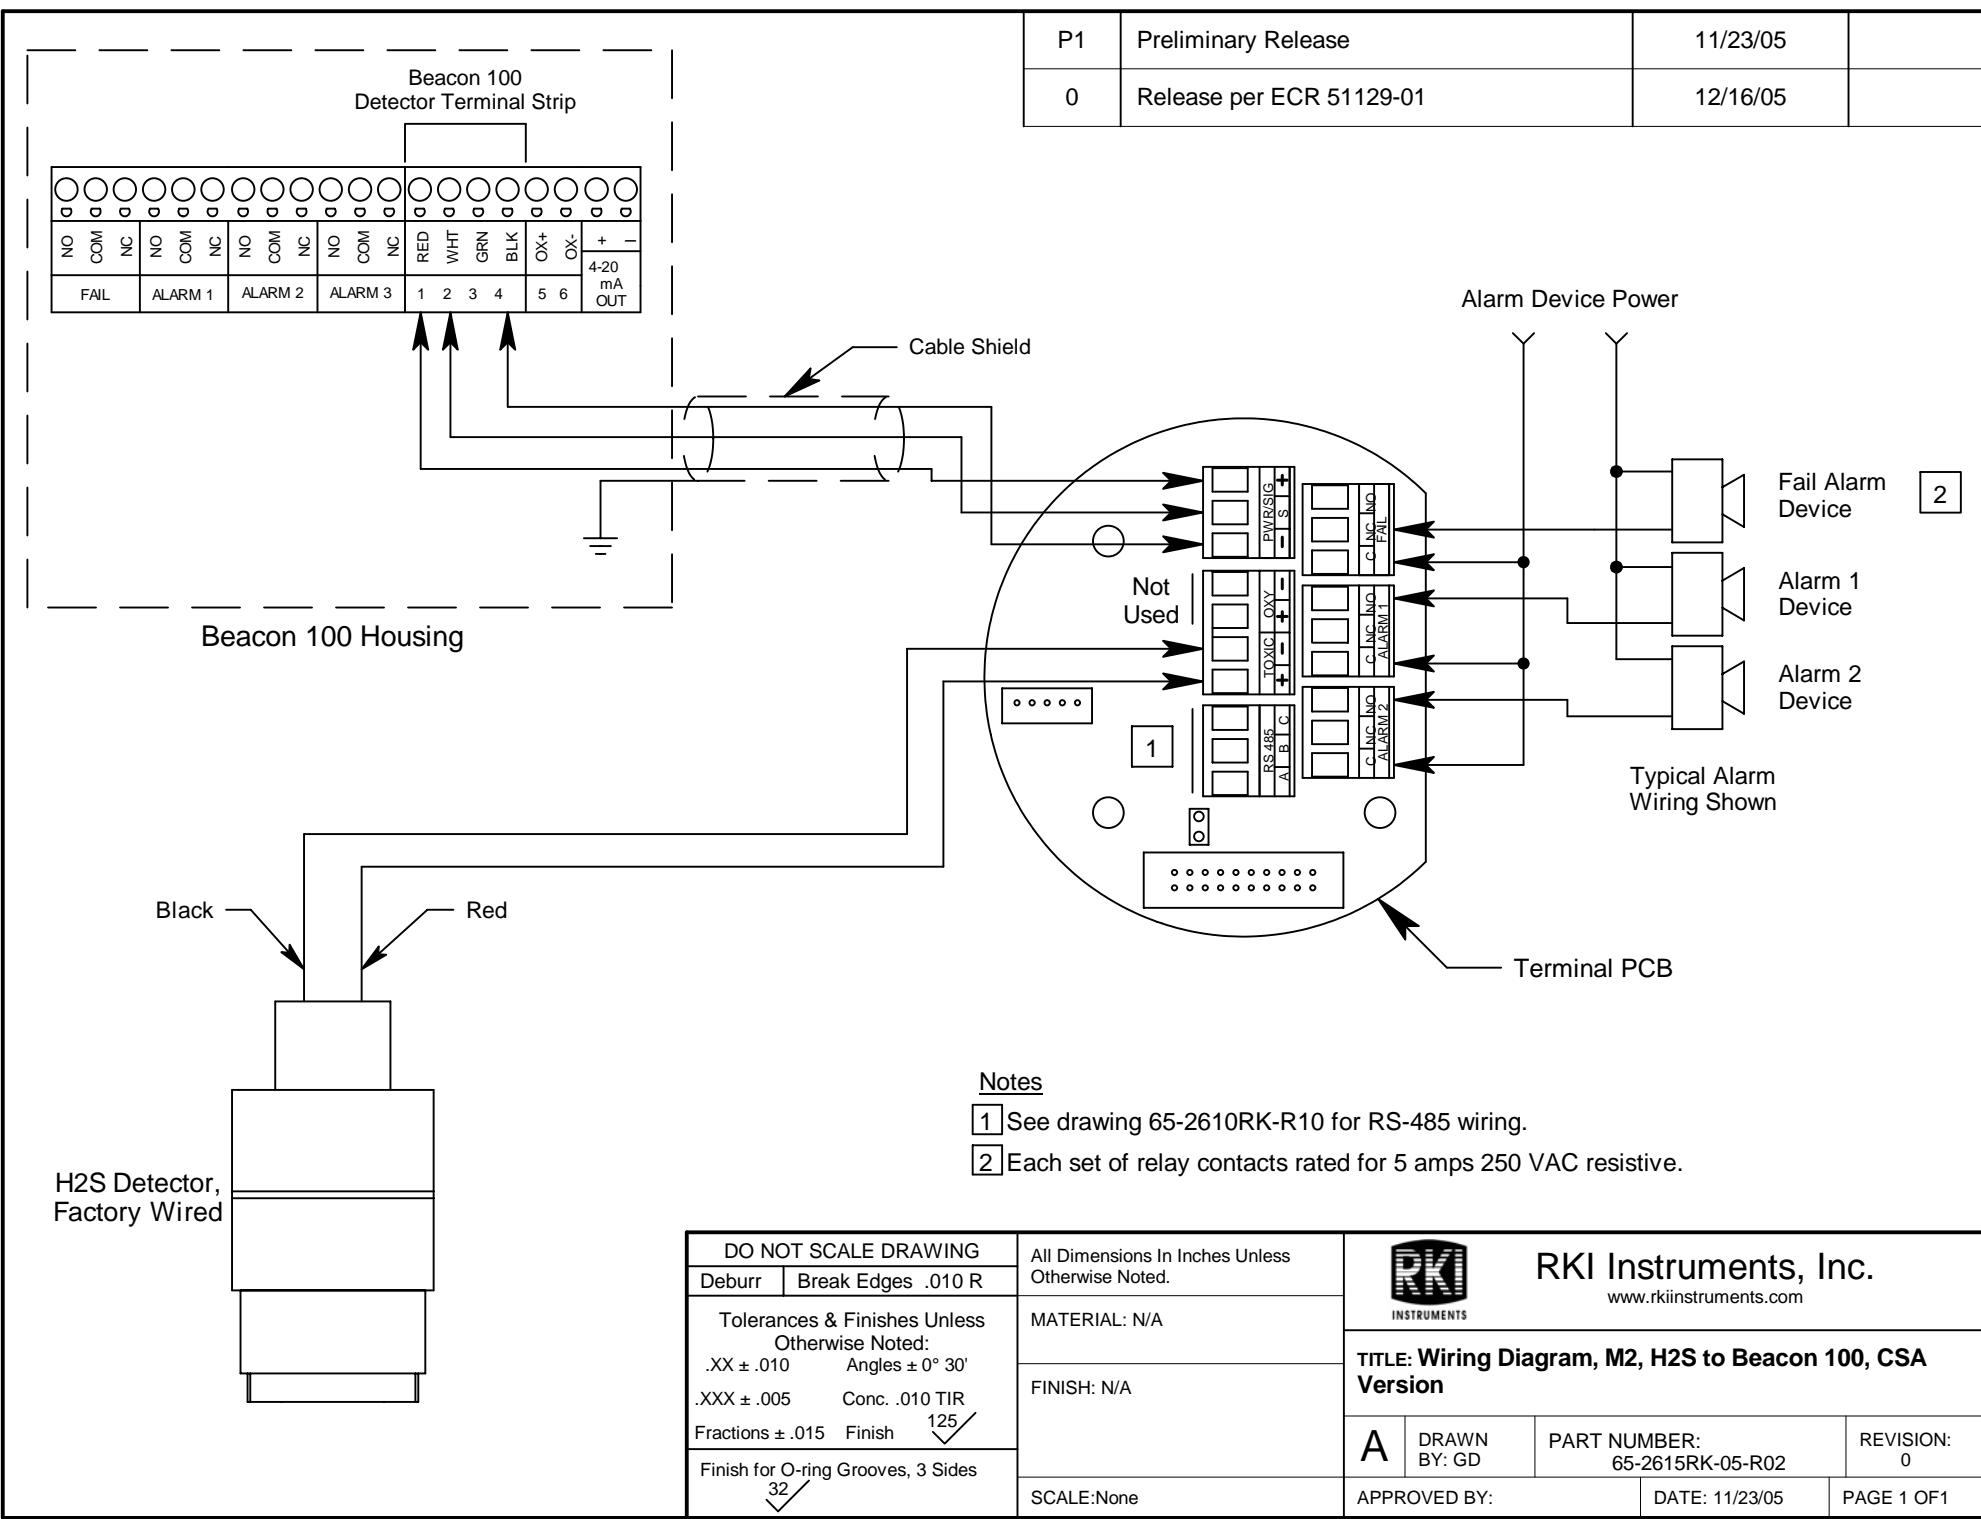

Notes

- 1 See drawing 65-2610RK-R10 for RS-485 wiring.
- 2 Each set of relay contacts rated for 5 amps 250 VAC resistive.

| | | | | | | | |
|---|--------------------|---|--|---|-----------------|----------------------------------|----------------|
| DO NOT SCALE DRAWING | | All Dimensions In Inches Unless Otherwise Noted. | | <div><div>RKI Instruments, Inc.</div><div>www.rkiinstruments.com</div></div> | | | |
| Deburr | Break Edges .010 R | | | | | | |
| Tolerances & Finishes Unless Otherwise Noted: | | MATERIAL: N/A | | TITLE: Wiring Diagram, M2, H2S to Beacon 100, CSA Version | | | |
| .XX ± .010 Angles ± 0° 30' | | FINISH: N/A | | | | | |
| .XXX ± .005 Conc. .010 TIR | | SCALE:None | | A | DRAWN BY: GD | PART NUMBER: 65-2615RK-05-R02 | REVISION: 0 |
| Fractions ± .015 Finish <div>125</div> | | | | | | | |
| Finish for O-ring Grooves, 3 Sides <div>32</div> | | | | APPROVED BY: | | DATE: 11/23/05 | PAGE 1 OF 1 |