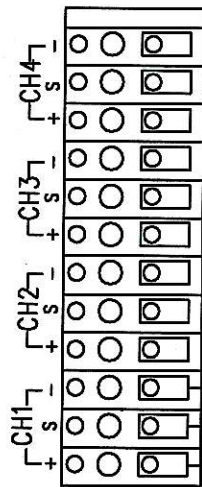
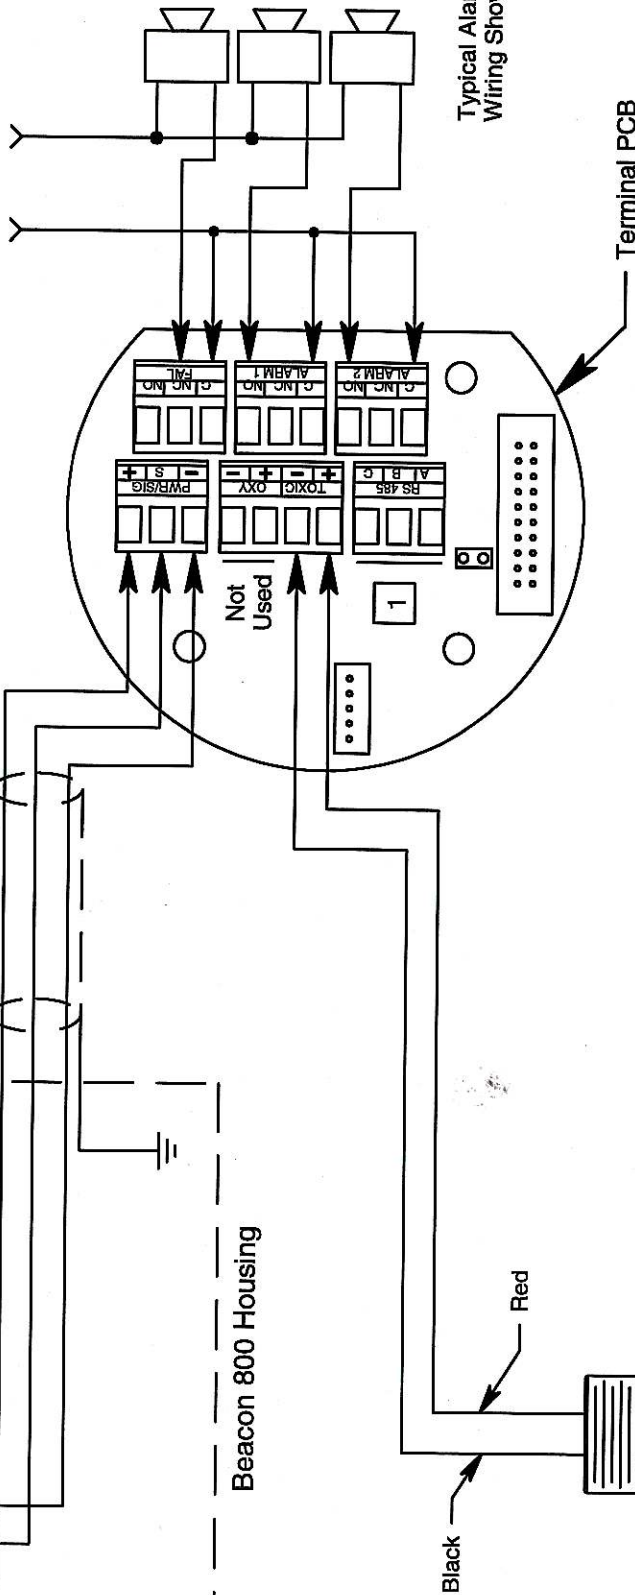


**Detector Wiring**

Beacon 800 Housing

Cable Shield

Alarm Device Power

**Notes**

- 1 See drawing 65-2610RK-R10 for RS-485 wiring.
- 2 Each set of relay contacts rated for 5 amps 250 VAC resistive.

**MASTER**CO Detector,  
Factory Wired**DO NOT SCALE DRAWING**

Deburr Break Edges .010 R

Tolerances & Finishes Unless  
Otherwise Noted:

.XX ± .010 Angles ± 0° 30'

.XXX ± .005 Conc. .010 TIR

Fractions ± .015 Finish 125

Finish for O-ring Grooves, 3 Sides

32

**RKI Instruments, Inc.**

www.rkiinstruments.com

**TITLE: Wiring Diagram, M2, NON XP CO to Beacon 800****A** DRAWN BY: GD PART NUMBER: 65-2633RK-R04 REVISION: P1

APPROVED BY: DATE: 02/05/10 PAGE 1 OF 1